



This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

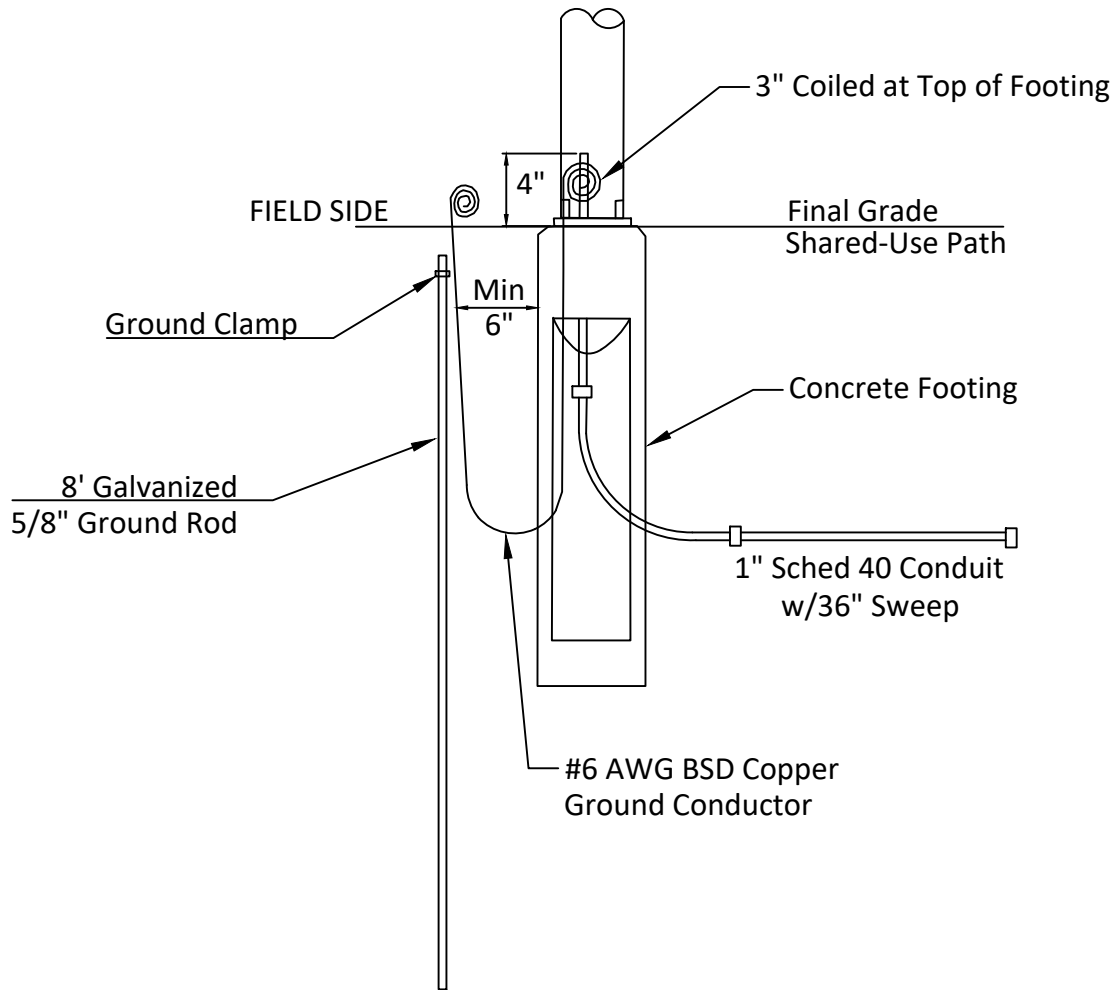

NOTES:

1. CONTRACTOR TO PROVIDE AND INSTALL GROUND ROD & COPPER WIRE.
2. THE GROUND ROD & #6 AWG CU BSD MUST BE INSTALLED DURING FOOTING INSTALLATION.
3. THE GROUND ROD MUST BE INSTALLED IN UNDISTURBED SOIL AT LEAST 2" BELOW FINAL GRADE, PER NESC 215C.
4. CONTRACTOR TO COIL 3" OF COPPER WIRE AROUND TOP OF GROUND ROD, AND MAKE FINAL CONNECTIONS.
5. GROUNDING IS ACCOMPLISHED BY CONNECTING THE NEUTRAL CONDUCTOR (GREEN CONDUCTOR) TO THE GROUNDING CONDUCTOR NEAR THE POLE GROUNDING TAB.

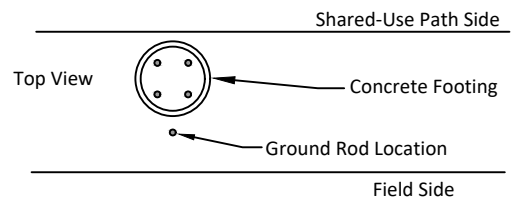

Shared-Use Path Lighting – Ground Rod Installation

DRAWING NO:	RD-1335	DRAFTED BY:	S. SHORTES	REV	DATE	APPR
FILE NAME:	RD-1335.DWG	APPROVED BY:	Z. WEIGEL	1	06/21	ZJW
SCALE:	NTS	EFFECTIVE DATE:	6/10/2021			

CITY OF
WILSONVILLE
OREGON

PUBLIC WORKS STANDARDS

